


Cooperative to provide and install cable from CVEC Pole to meter base
 Consumer to provide a ditch per Cooperative's specifications
 Consumer to provide all material beyond the meter base



8' ground rod, clamp and #6 bare copper ground wire
 (Supplied and installed by consumer)
 Grounding conductor shall be connected from the
 ground lug in meter base to the ground rod(s)
 Cooperative requires the meter base to be grounded

**PERMANENT UNDERGROUND SERVICE FROM
 CVEC POLE TO SERVICE POLE (H-structure)
 (MAX 400AMP)**

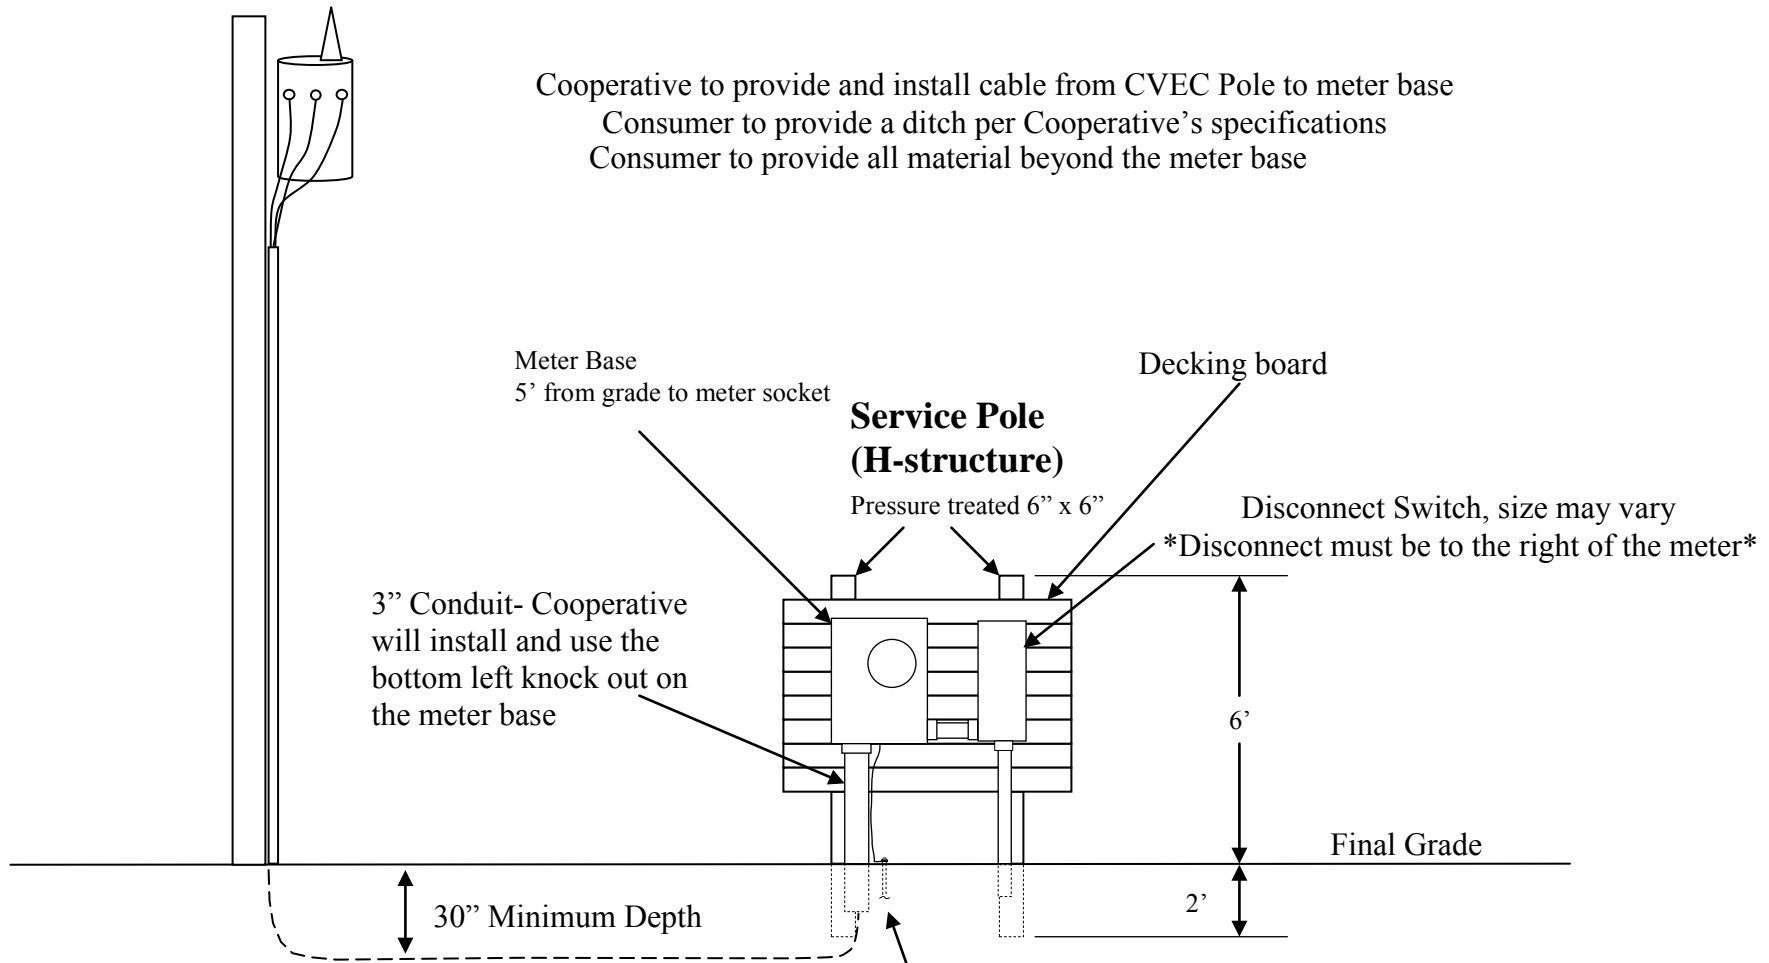

CENTRAL VIRGINIA
 ELECTRIC COOPERATIVE

11/07/2012